




# UNDERGROUND METER RACK

Phone: 817.444.3201 ★ tcctexas.com

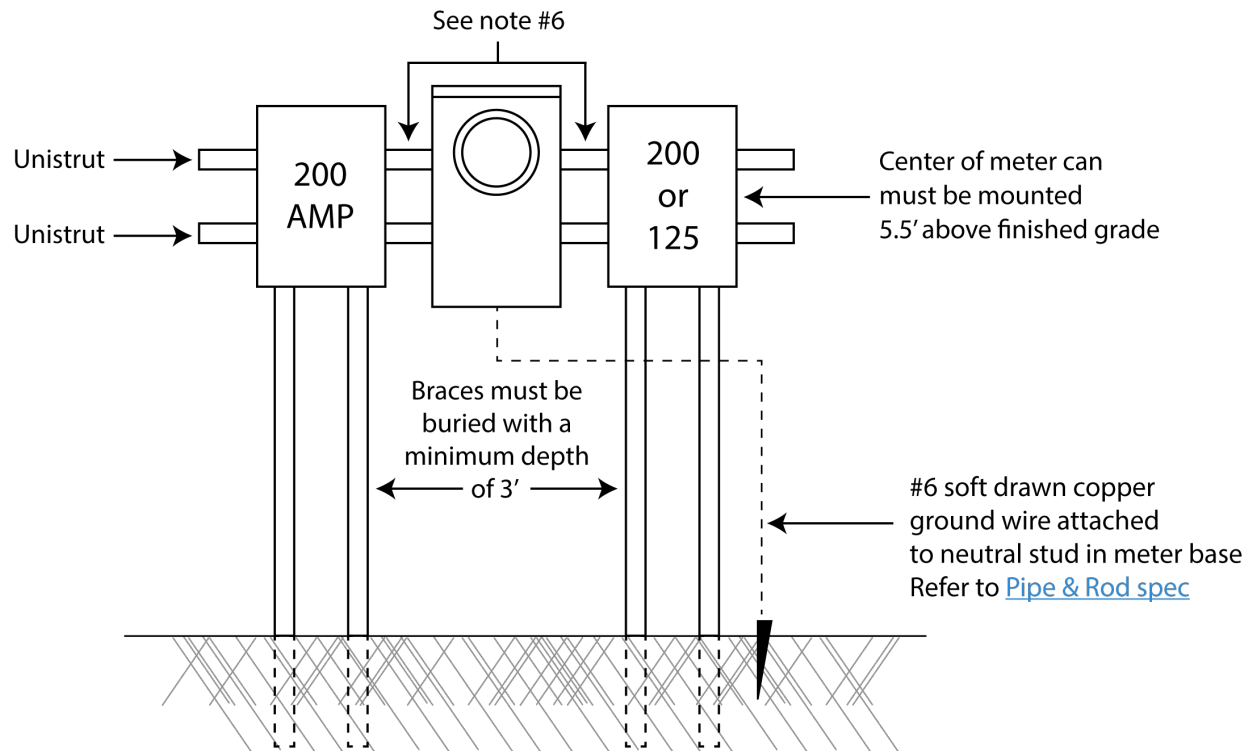

## NOTES:

1. Meter sockets must conform to specifications furnished by Tri-County Electric Cooperative and mounted approximately 5.5' above finished grade.
2. Member installation must comply with National Electric Code and applicable city ordinance.
3. Main disconnect cannot have a rating larger than the meter base.
4. New construction not receiving a meter 10 days after construction is complete will be billed the minimum charge based on the applicable rate schedule.
5. If a request is made to connect service and the meter loop fails to meet requirements, Tri-County Electric Cooperative will not connect service and will bill the account for applicable trip charge.
6. A #6 copper bond wire must be installed between both breaker boxes and meter base. An external breaker below or beside the meter base is required if the distance between meter base and panel exceeds 3 feet. Refer to [Meter Can Bonding spec](#)