


# METER CAN BONDING


## Internal and External Breaker Cabinets

**Internal Breaker Cabinet**




Ground wire must be landed per meter can manufacturer


#6 soft drawn copper

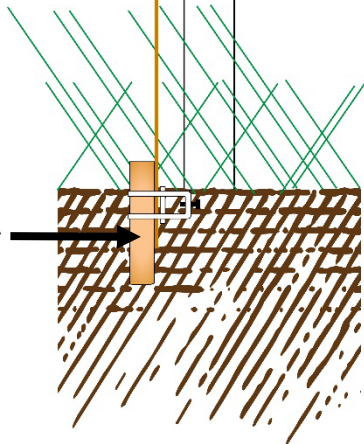

**Internal Breaker Cabinet (Side View)**

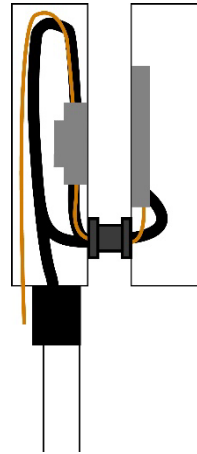


**External Breaker Cabinet**

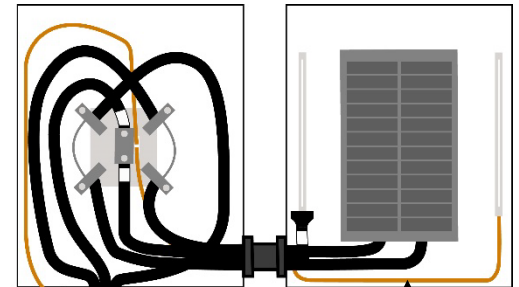

Ground wire must be landed per meter can manufacturer

#6 soft drawn copper

Ground wire must be carried through

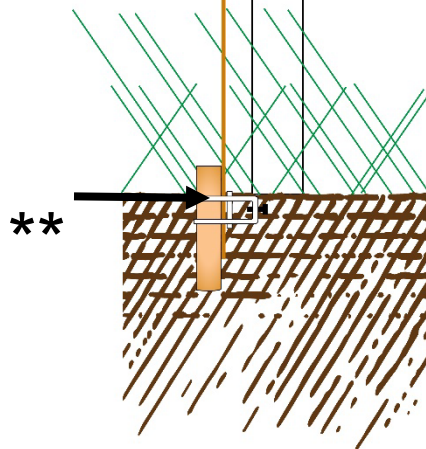

\*\*Refer to Installation Requirements: Rod + Pipe Electrodes for ground installation